

374 FC/375 FC/376 FC

Clamp Meters

Users Manual

September 2015 Rev. 3, 4/23

© 2015-2023 Fluke Corporation. All rights reserved. Specifications are subject to change without notice.
All product names are trademarks of their respective companies.

LIMITED WARRANTY AND LIMITATION OF LIABILITY

This Fluke product will be free from defects in material and workmanship for three years from the date of purchase. This warranty does not cover fuses, disposable batteries, or damage from accident, neglect, misuse, alteration, contamination, or abnormal conditions of operation or handling. Resellers are not authorized to extend any other warranty on Fluke's behalf. To obtain service during the warranty period, contact your nearest Fluke authorized service center to obtain return authorization information, then send the product to that Service Center with a description of the problem.

THIS WARRANTY IS YOUR ONLY REMEDY. NO OTHER WARRANTIES, SUCH AS FITNESS FOR A PARTICULAR PURPOSE, ARE EXPRESSED OR IMPLIED. FLUKE IS NOT LIABLE FOR ANY SPECIAL, INDIRECT, INCIDENTAL OR CONSEQUENTIAL DAMAGES OR LOSSES, ARISING FROM ANY CAUSE OR THEORY. Since some states or countries do not allow the exclusion or limitation of an implied warranty or of incidental or consequential damages, this limitation of liability may not apply to you.

Fluke Corporation
P.O. Box 9090
Everett, WA 98206-9090
U.S.A.

Fluke Europe B.V.
P.O. Box 1186
5602 BD Eindhoven
The Netherlands

Table of Contents

Title	Page
Introduction.....	1
Contact Fluke	2
Safety Information	3
Replacement Part List	4
The Product.....	5
Install Fluke Connect® App.....	16
Wireless Radio Setup	17
General Specifications	20
Product Disposal	27

Introduction

The Fluke 374 FC/375 FC/376 FC (the Product) measures true-rms ac current and voltage, dc current and voltage, inrush current, resistance, and capacitance. The 375 FC and 376 FC also measure frequency and dc millivolts. The detachable iFlex (Flexible Current Probe) that is included with the 376 FC (optional with the 374 FC and 375 FC) expands the measurement range to 2500 A ac. The Flexible Current Probe provides increased display flexibility and allows measurements of awkward sized conductors and improved wire access. The illustrations in this manual show the 376 FC.

Contact Fluke

Fluke Corporation operates worldwide. For local contact information, go to our website:

www.fluke.com

To register your product, view, print, or download the latest manual or manual supplement, go to our website.

+1-425-446-5500

fluke-info@fluke.com.

Safety Information

A **Warning** identifies conditions and procedures that are dangerous to the user. A **Caution** identifies conditions and procedures that can cause damage to the Product or the equipment under test.

General Safety Information in the printed Safety Information document that ships with the Product. It can also be found online at www.fluke.com. More specific safety information is listed in this manual where applicable.

Replacement Part List

Table 1 lists the available replacement parts.

Table 1. Replacement Parts

Item	Qty.	Fluke Part or Model Number
Battery, AA 1.5 V	2	376756
Battery Door Assembly	1	4696918
Test lead set	1	TL75
Flexible current probe i2500-10	1	3676410
Flexible current probe i2500-18	1	3798105
Magnet strap	1	669952
STRAP 9 INCHES	1	669960
Soft Case	1	3752958

The Product


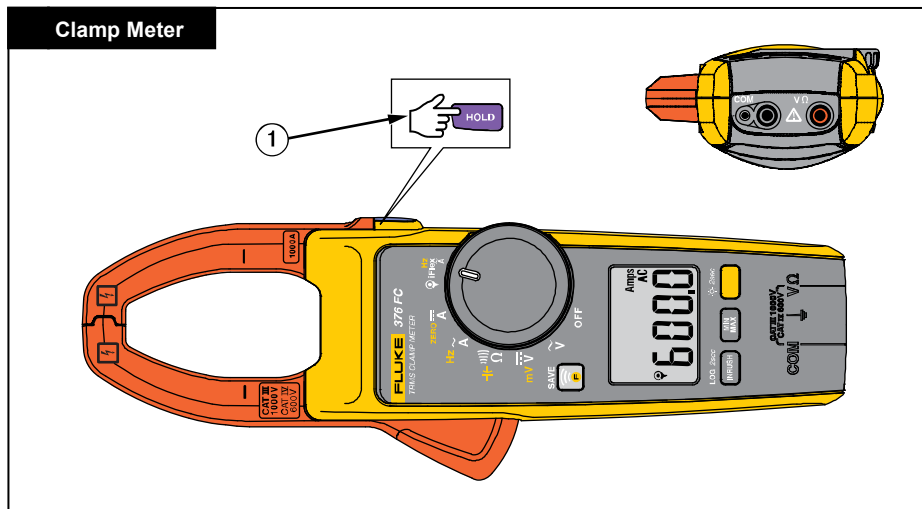


fig01.emf

Auto Power Off

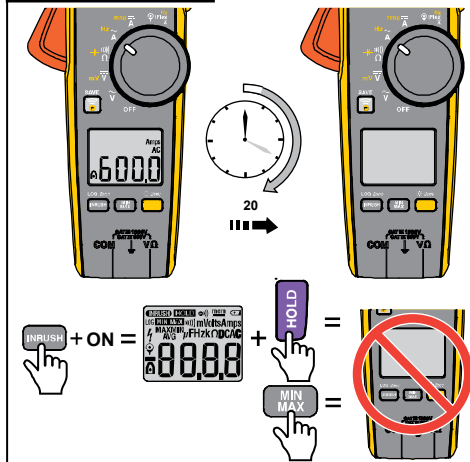

Backlight


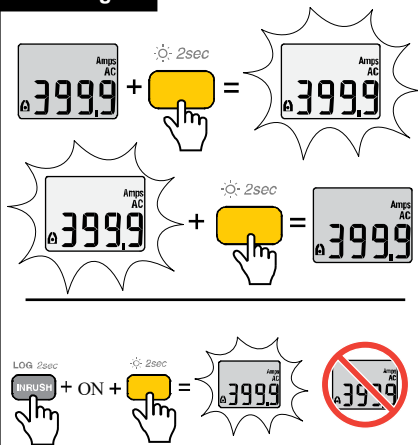


fig02_3.emf

Display Hold

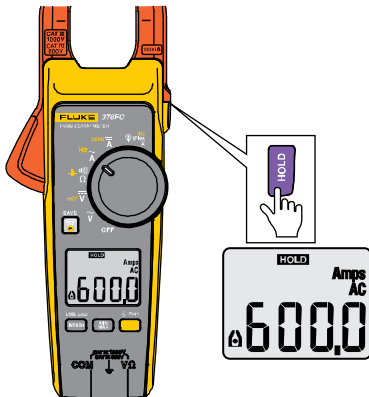

MIN MAX AVG

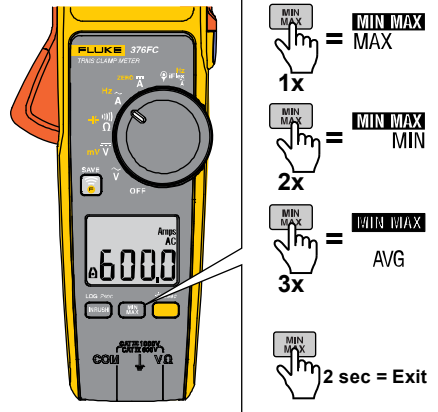



fig04_5.emf

LOG (375 FC /376 FC)

LOG 2sec



2 sec = LOG



Clear Memory (375 FC / 376 FC)

LOG 2sec



+ ON +

SAVE



x1



SAVE



x2



5 sec



fig_16.emf

~ Flexible Current Probe

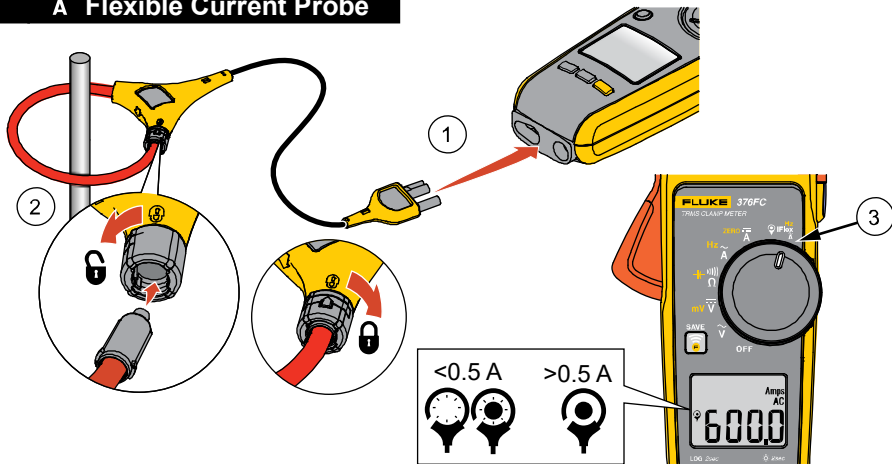


fig06.emf

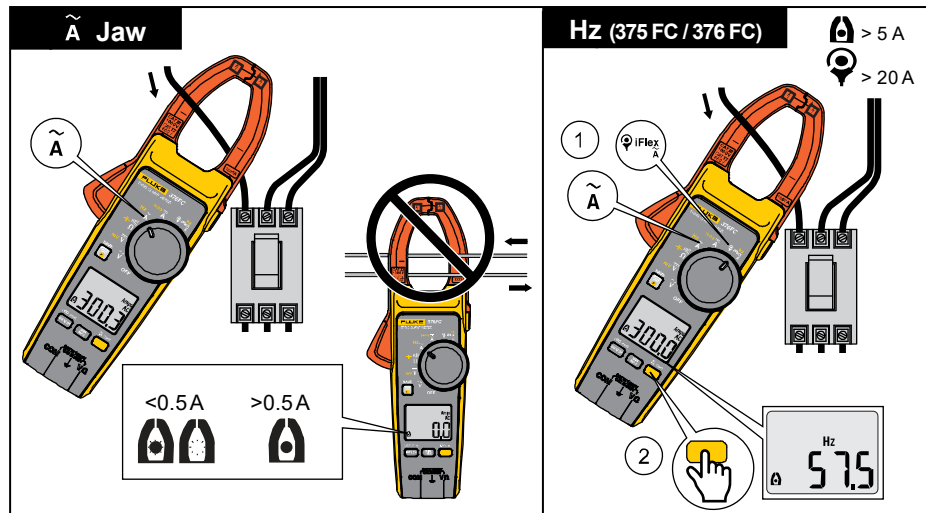


fig07.emf

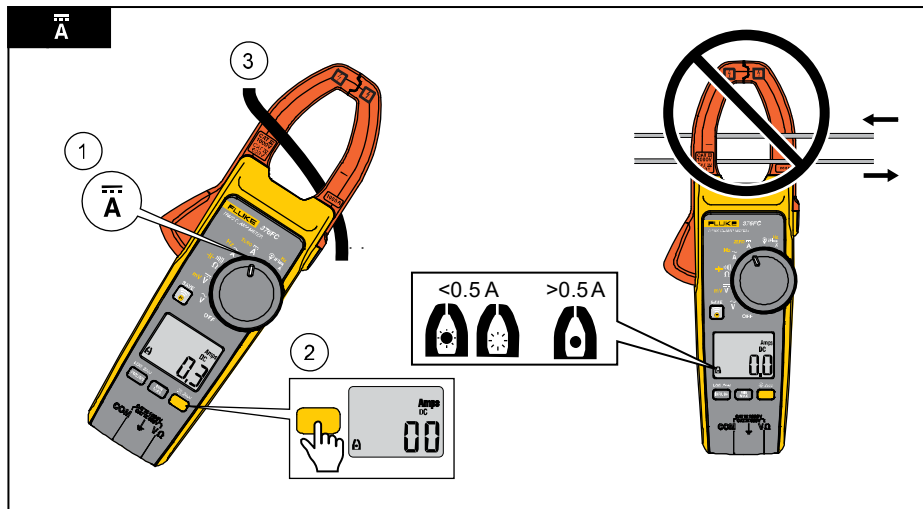


Fig08.emf

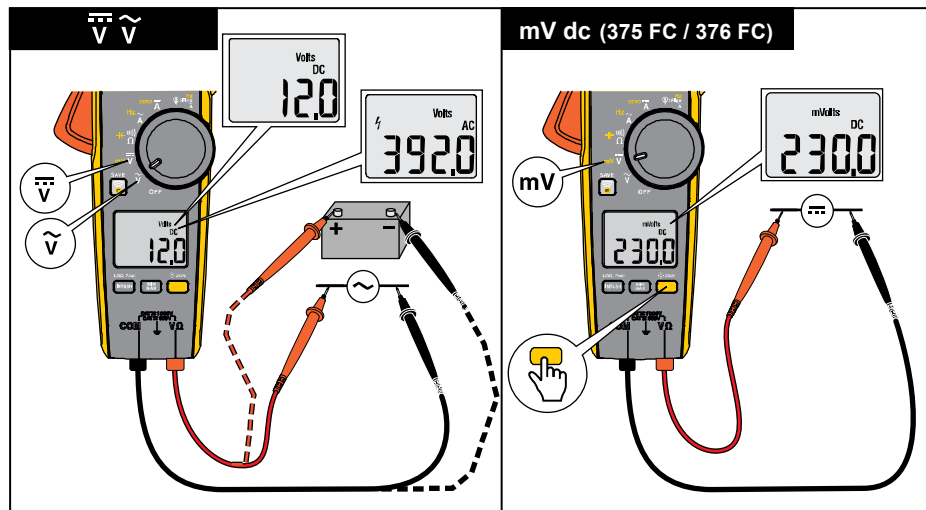


fig09_10.emf

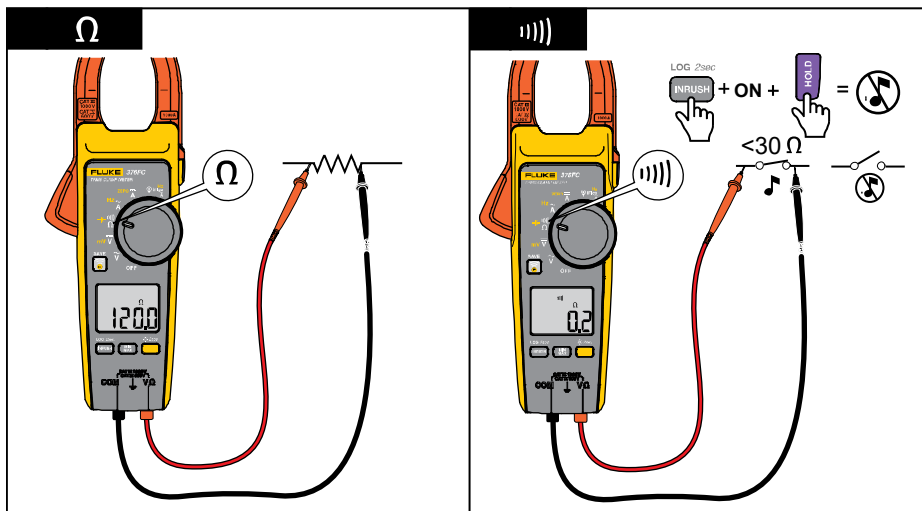


Fig15.emf

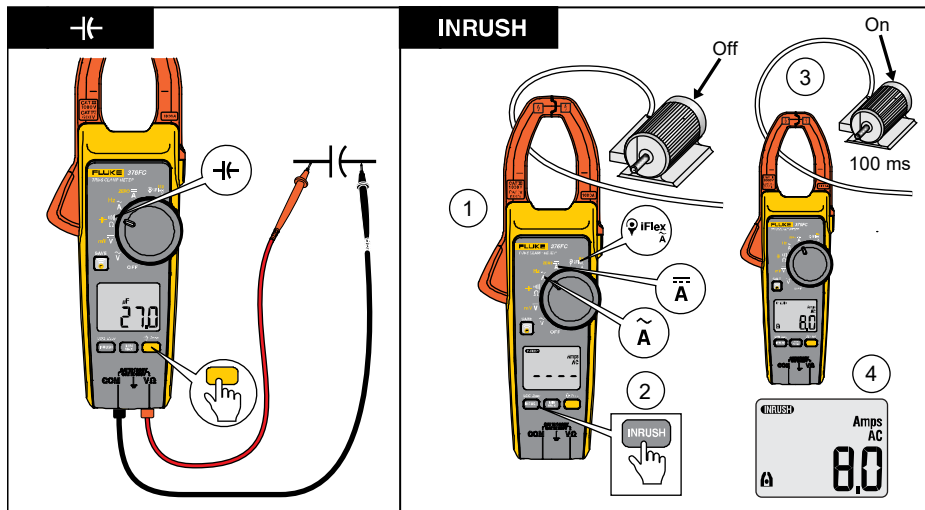


fig13_14.emf

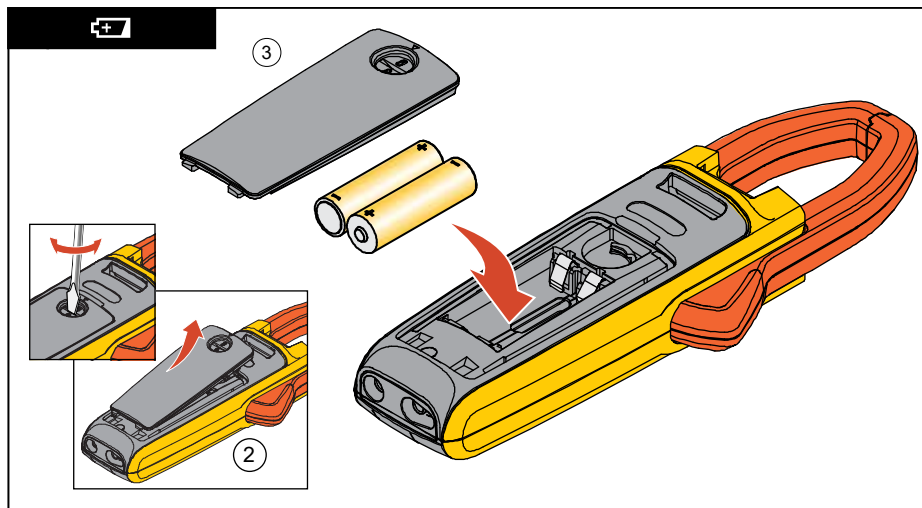



fig11_12.emf

Install Fluke Connect® App




Install_Flukeconnect_App.jpg

Wireless Radio Setup

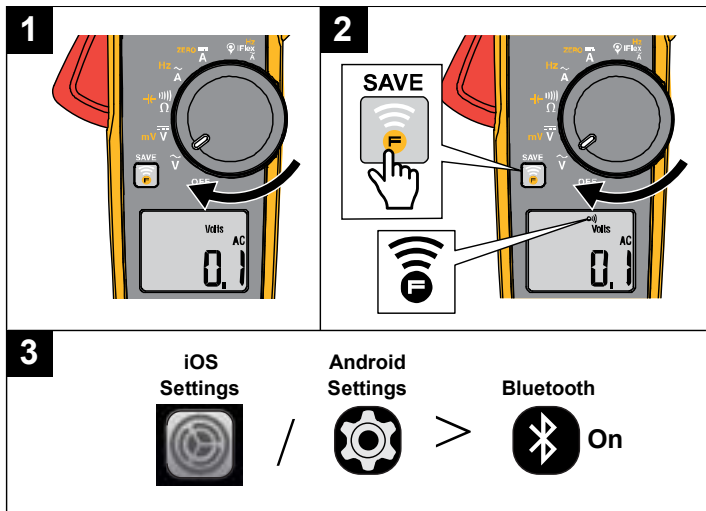


WirelessRadioSetup1-3.emf

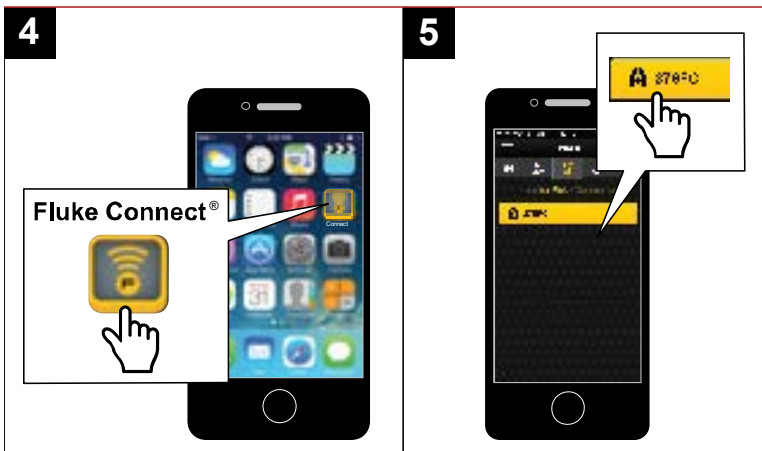

WirelessRadioSetup4-5.emf


6

Blink = 4-5 s



Go to www.flukeconnect.com

7



General Specifications

Safety specifications are in the printed Safety Information that shipped with the Product.

Size (L x W x H) 249 mm x 85 mm x 45 mm

Weight..... 410 g

Jaw Opening 34 mm

Flexible Current Probe Diameter 7.5 mm

Flexible Current Probe Cable Length
(head to electronics connector) 1.8 m

Temperature

Coefficients Add 0.1 x specified accuracy for each degree C >28 °C
or <18 °C

AC Current via Jaw

Range

374 FC and 375 FC 600.0 A

376 FC..... 999.9 A

Resolution 0.1 A

Accuracy 2 % ± 5 digits (10 Hz to 100 Hz)
2.5 % ± 5 digits (100-500 Hz)

Crest Factor (50 Hz/60 Hz)


376 FC	3 @ 500 A
	2.5 @ 600 A
	1.42 @ 1000 A
374 FC and 375 FC	2.5 @ 350 A
	1.42 @ 600 A

Note: Add 2 % for C.F. >2

AC Current via Flexible Current Probe

Range	2500 A
Resolution	0.1 A (≤ 999.9 A)
	1 A (≤ 2500 A)
Accuracy	3 % ± 5 digits (5 – 500 Hz)
Crest Factor (50 Hz/60 Hz)	3.0 @ 1100 A
	2.5 @ 1400 A
	1.42 @ 2500 A
	Add 2 % for C.F. >2

Position Sensitivity

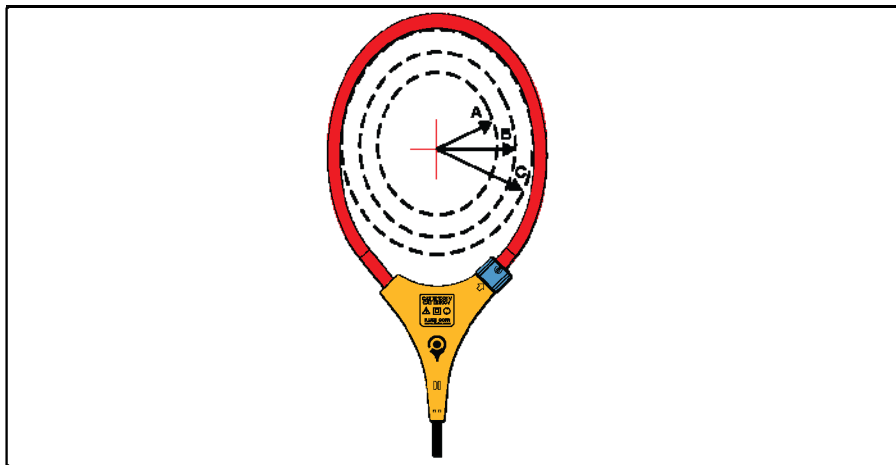

ghn12.png

Figure 1. Position Sensitivity

Distance from Optimum	i2500-10 Flex	i2500-18 Flex	Error
A	0.5 in (12.7 mm)	1.4 in (35.6 mm)	±0.5 %
B	0.8 in (20.3 mm)	2.0 in (50.8 mm)	±1.0 %
C	1.4 in (35.6 mm)	2.5 in (63.5 mm)	±2.0 %
Measurement uncertainty assumes centralized primary conductor at optimum position, no external electrical or magnetic field, and within operating temperature range.			

DC Current

Range

374 FC and 375 FC 600.0 A

376 FC 999.9 A

Resolution 0.1 A

Accuracy 2 % ±5 digits

374 FC/375 FC/376 FC

Users Manual

AC Voltage

Range 1000 V

Resolution 0.1 V (≤ 600.0 V)

1 V (≤ 1000 V)

Accuracy (374 FC/375 FC) 1.5 % ± 5 digits (20 Hz to 500 Hz)

(376 FC) 1 % ± 5 digits

DC Voltage

Range 1000 V

Resolution 0.1 V (≤ 600.0 V)

1 V (≤ 1000 V)

Accuracy 1 % ± 5 digits

mV dc (375 FC and 376 FC)

Range 500.0 mV

Resolution 0.1 mV

Accuracy 1 % ± 5 digits

Frequency via Jaw

Range

375 FC and 376 FC 5.0 Hz to 500.0 Hz

Resolution 0.1 Hz

Accuracy 0.5 % ± 5 digits

Trigger Level 5 Hz to 10 Hz, ≥ 10 A

10 Hz to 100 Hz, ≥ 5 A

100 Hz to 500 Hz, ≥ 10 A

Frequency via Flexible Current Probe

Range

375 FC and 376 FC 5.0 Hz to 500.0 Hz

Resolution 0.1 Hz

Accuracy 0.5 % ± 5 digits

Trigger Level 5 Hz to 20 Hz, ≥ 25 A

20 Hz to 100 Hz, ≥ 20 A

100 Hz to 500 Hz, ≥ 25 A

Resistance

Range

374 FC 6000 Ω

375 FC and 376 FC 60 k Ω

Resolution

374 FC 0.1 Ω ($\leq 600 \Omega$)

1 Ω ($\leq 6000 \Omega$)

375 FC and 376 FC 0.1 Ω ($\leq 600 \Omega$)

1 Ω ($\leq 6000 \Omega$)

10 Ω ($\leq 60 \text{ k}\Omega$)

Accuracy 1 % ± 5 digits

Capacitance

Range 1000 μF

Resolution 0.1 μF ($\leq 100 \mu\text{F}$)

1 μF ($\leq 1000 \mu\text{F}$)

Accuracy 1 % ± 4 digits

Product Disposal

Dispose of the Product in a professional and environmentally sound manner:

- Delete personal data on the Product before disposal.
- Remove batteries that are not integrated into the electrical system before disposal and dispose of batteries separately.
- If this Product has an integral battery, put the entire Product in the electrical waste.

